REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

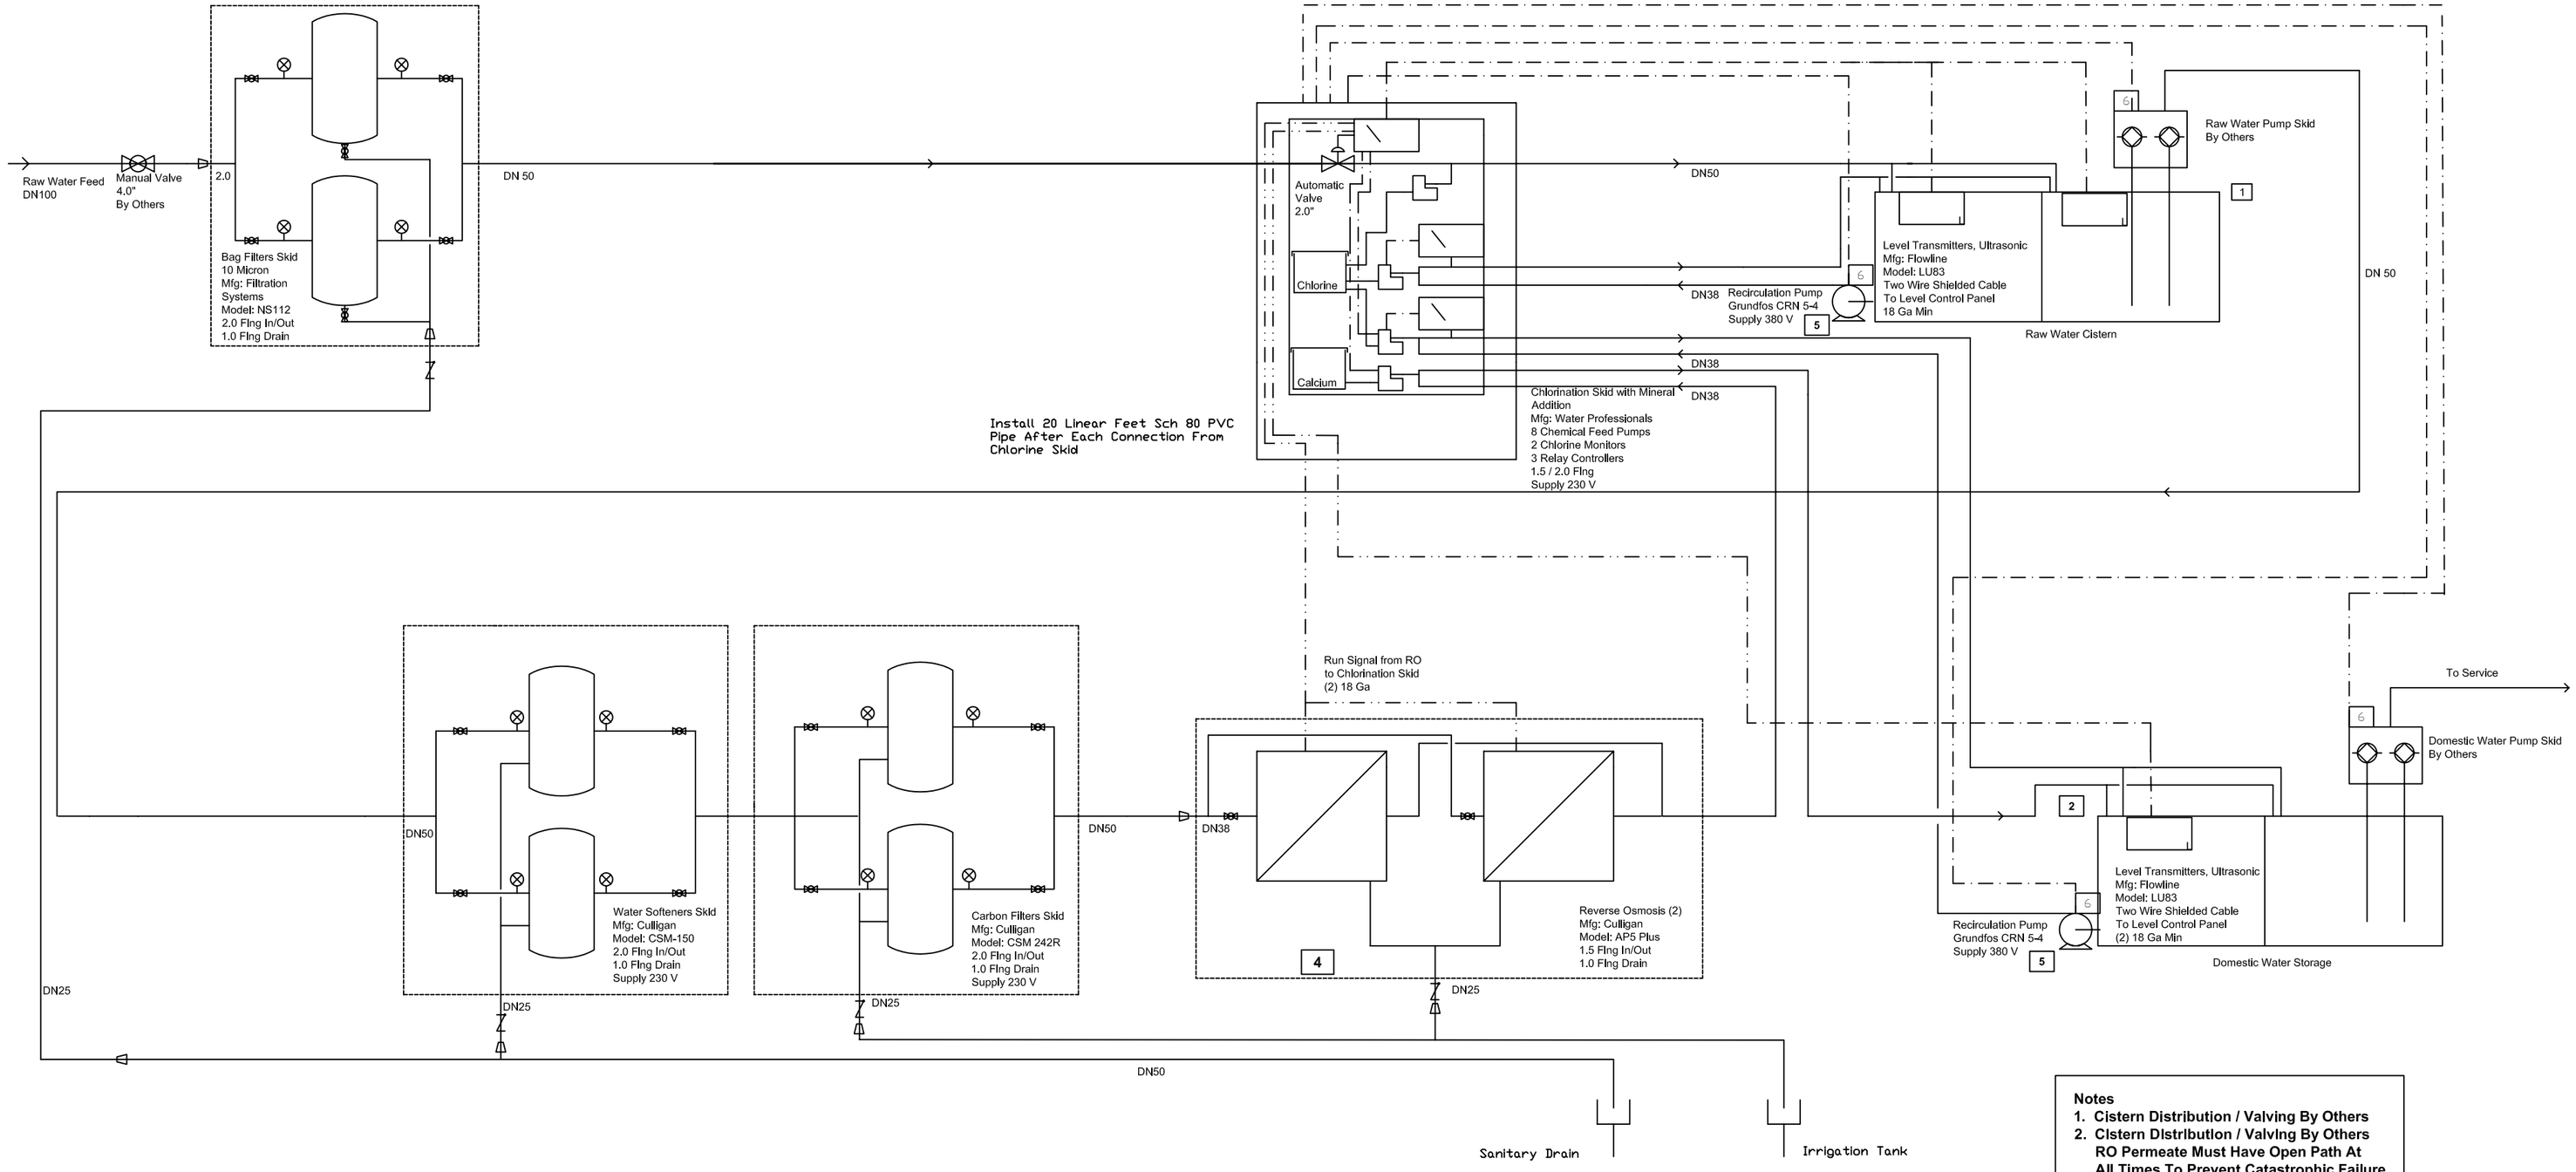

Notes

1. **Cistern Distribution / Valving By Others**
2. **Cistern Distribution / Valving By Others RO Permeate Must Have Open Path At All Times To Prevent Catastrophic Failure**
3. **Do Not Allow Back Pressure To RO**
4. **230 V, 25 Amp Disconnect For Control Panel Supplied By Others**
5. **Recirculation Pump Starter/ Disconnect Supplied By Others 0.75 hp, 380 V, 3 ph, 1.44 A**
6. **Run Permissive Signals**

The Water Professionals
P.O. Box 2820
Greenville, SC 29642
864-295-9500
www.waterprofessionals.biz

Process and Instrumentation Diagram

Sample

8 July 2008	SIZE C	FSCM NO.	DWG NO. Sample	REV 3
SLB	SCALE		SHEET	